

INDUSTRIAL THERMOCOUPLES

| A | CODE | HEAD EXTENSION |
|---|------|-------------------------------|
| | 1 | (NO EXTENSION, 0" "A" LENGTH) |
| | 3 | NIPPLE/UNION/ (NOTE 1) |

| B | CONNECTION HEAD | | | |
|---|-----------------|--------------------------------------|---|-------|
| | CODE | MATERIAL | TYPE | NEMA |
| | AN | ALUMINUM | WATER PROOF | 4 |
| | SN | STAINLESS STEEL | WATER PROOF, CORROSION RESISTANT | 4, 4X |
| | AE | ALUMINUM | EXPLOSION PROOF (NOTE 2) | 4 |
| | SE | STAINLESS STEEL | EXPLOSION PROOF, CORROSION RESISTANT (NOTE 2) | 4, 4X |
| | XD | ALUMINUM | EXPLOSION PROOF, FM, CSA APPROVED (NOTES 2 & 3) | 4, 4X |
| | A | CAST IRON | WEATHER PROOF, RUGGED | |
| | AX | ALUMINUM, LARGE DEVICE, EPOXY COATED | EXPLOSION PROOF, ATEX APPROVED (NOTE 3) | 4 |

| C | CODE | CONDUIT OPENING | D | CODE | TUBE OPENING | E | CODE | "A" LENGTH |
|---|------|-----------------|---|------|------------------------|---|------|------------|
| | | 1/2 or 3/4NPT | | | 1/2 or 3/4NPT (NOTE 4) | | | IN INCHES |

| F | ELEMENT CONSTRUCTION | | | | | | |
|---|----------------------|---------|----------|----------|-----------------|------------|---------------|
| | CODE | SINGLE | DUPLEX | DIAMETER | WIRE SIZE (AWG) | INSULATION | SPRING LOADED |
| | A14 | AD14 | 1/4" | 18 | MgO-SHEATH | NO | |
| | ASL14 | ADSL14 | 1/4" | 18 | MgO-SHEATH | YES | |
| | A516 | AD516 | 5/16" | 16 | MgO-SHEATH | NO | |
| | ASL516 | ADSL516 | 5/16" | 16 | MgO-SHEATH | YES | |
| | A38 | AD38 | 3/8" | 15 | MgO-SHEATH | NO | |
| | ASL38 | ADSL38 | 3/8" | 15 | MgO-SHEATH | YES | |
| | B14 | BD14 | .325" | 14 | CERAMIC BEAD | NO | |
| | B08 | BD08 | .5"-.69" | 8 | CERAMIC BEAD | NO | |

| G | CODE | | CALIBRATION |
|---|----------|------------------|--|
| | STANDARD | SPECIAL (NOTE 5) | |
| | J | JJ | IRON (+) vs CONSTANTAN (-) |
| | K | KK | CHROMEL (+) vs ALUMEL (-) |
| | T | TT | COPPER (+) vs CONSTANTAN (-) |
| | E | EE | CHROMEL (+) vs CONSTANTAN (-) |
| | N | NN | NICROSIL (+) vs NISIL (-) |
| | - | KKS | CHROMEL (+) vs ALUMEL (-) (NOTE 6) |
| | - | EES | CHROMEL (+) vs CONSTANTAN (-) (NOTE 6) |

| H | MEASURING JUNCTION | |
|----|---|---|
| | CODE | DESCRIPTION |
| | G | SINGLE GROUNDED, GROUNDED TO SHEATH |
| | U | SINGLE UNGROUNDED, ISOLATED FROM SHEATH |
| DG | DUPLEX GROUNDED, GROUNDED TO SHEATH | |
| DU | DUPLEX UNGROUNDED, ISOLATED FROM SHEATH | |

| J | CODE | ELEMENT SHEATH MATERIAL | STANDARD CALIBRATIONS (NOTE 6) |
|---|------|-------------------------|--------------------------------|
| | P | 304 STN. STL. | J, K, T |
| | R | 316 STN. STL. | J, K, T, E, N |
| | Q | 310 STN. STL. | J, K, E |
| | J | INCONEL 600 | K, N, KKS, EES (NOTE 6) |

DROP CODE WHEN USING CERAMIC BEADED ELEMENTS

| K | PROTECTION TUBE TYPE | | | |
|---|----------------------|-----------|-------------|-------|
| | CODE | TUBE SIZE | PROCESS NPT | OD |
| | 601 | | 1/2" NPT | |
| | 602 | 1/4" NPS | 3/4" NPT | 0.540 |
| | 603 | | 1" NPT | |
| | 606 | | 3/4" NPT | |
| | 607 | 1/2" NPS | 1" NPT | 0.840 |
| | 608 | | 1 1/4" NPT | |
| | 610 | | 1" NPT | |
| | 611 | 3/4" NPS | 1 1/4" NPT | 1.050 |
| | 612 | | 1 1/2" NPT | |
| | 613 | 1" NPS | 1 1/4" NPT | 1.315 |
| | 614 | | 1 1/2" NPT | |

| L | TUBE SCHEDULE (INSIDE DIAMETER) | | | | |
|-----|---------------------------------|---------|---------|---------|-------|
| | CODE | 1/4"NPT | 1/2"NPT | 3/4"NPT | 1"NPT |
| | 40 | 0.364 | 0.622 | 0.824 | 1.049 |
| | 80 | 0.302 | 0.546 | 0.742 | 0.957 |
| | 160 | N/A | 0.464 | 0.612 | 0.815 |
| XXS | N/A | N/A | 0.434 | 0.599 | |

Notes:

- Standard Nipples - Steel, Schedule 40.
Standard Unions - Black Malleable Iron, 150#.
- OPTIONAL STAINLESS STEEL
Nipples - 304 or 316 Stainless Steel, Schedule 40 or 80.
Unions - 304 or 316 Stainless Steel.
Example Ordering Code: 3AE 3/4 1/2 6(R or R80).
- Rated NEC class 1, Groups B, C and D.
- ATEX approved EEx d IIC, T6.
- For 1/4" and 1" pipe size a reducing bushing or enlarger will be used to fit tube opening, specify 1/2 for 1/4" pipe size and 3/4 for 1" pipe size.
- Meets or exceeds Special Initial Calibration Tolerances per ANSI MC96.1-1982 and ASTM E230-1993
- KKS & EES denotes stabilized thermocouple and special tolerance.
- Contact factory for other calibration and sheath combinations.
- For an item that does not fall within the catalog description an (SP) can be added to the ordering code as part of a custom construction.



| M | WELL MATERIAL | |
|---|----------------|-----------------------------|
| | CODE | DESCRIPTION |
| | P | 304 STAINLESS STEEL |
| | Q | 310 STAINLESS STEEL |
| | R | 316 STAINLESS STEEL |
| | PLorRL | 304or316 S. S. (LOW CARBON) |
| N | CARBON STEEL | |
| J | INCONEL 600 | |
| H | HASTELLOY C276 | |

| N | CODE | "F" LENGTH |
|---|------|---------------------|
| | | IN INCHES (3" STD.) |

| P | CODE | "U" LENGTH |
|---|------|------------|
| | | IN INCHES |

USE ONLY IF BUSHING MATERIAL IS NOT THE SAME AS TUBE MATERIAL

EXAMPLE: 3 AE 3/4 - 3/4 - 3 - ASL14 K U R - 611 - 80 - R - 3 - 48 (N)

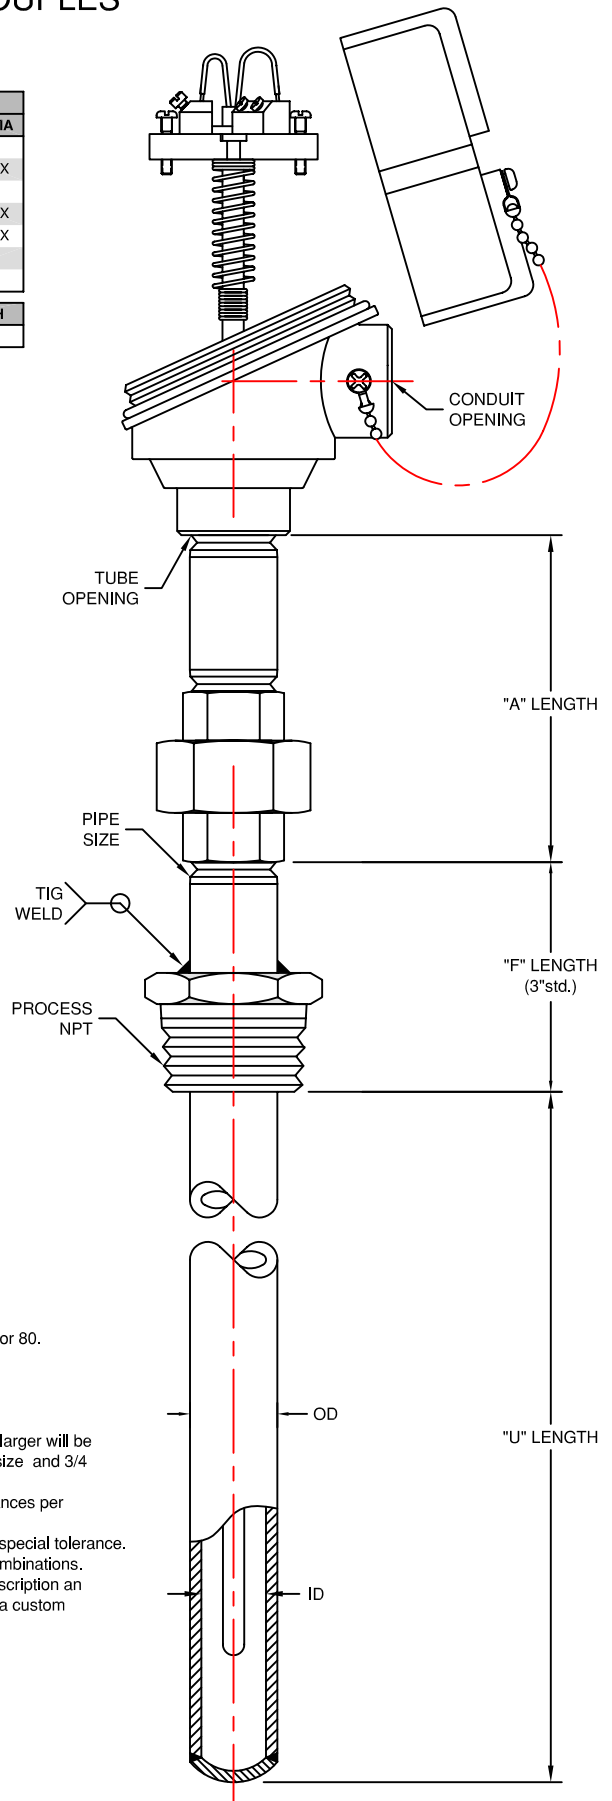

TEMPERATURE MEASUREMENT DESIGNER'S GUIDE
WWW.THERMO-ELECTRIC-DIRECT.COM

SECTION INTC

PIPE WELL ASSEMBLIES THREADED PROCESS CONNECTION

The information contained hereon shall be considered the sole property of Thermo Electric Company, Inc. The recipient thereof agrees not to disclose or reproduce said information to parties outside the recipient's organization without the written permission of Thermo Electric.

Doc. No.: TE-CO010109-INTC-130